

Our Ref: NC 6232/19

Your Ref: AI/GG

Date: 29 January 2019

Dear Sir/Madam,

**WATER (NORTHERN IRELAND) ORDER 1999
APPLICATION TO TRANSFER OWNERSHIP OF A DISCHARGE CONSENT**

YOUR CLIENT:

PREMISES AT: Magonragh, Lisbellaw, Co Fermanagh, BT94 5EP.

I enclose a copy of the above mentioned Order which the Department has granted as requested.

You should ensure that a copy of this letter is passed to your client's. The attached consent is a legal document which should be kept in a safe place as it will be required in the event of the sale or re-mortgage of the property at a future date. It is an offence to contravene the conditions of this consent and failure to comply may make you liable for prosecution.

In order to ensure that the effluent discharged complies with the conditions in the consent, samples may be taken from time to time by the Department's inspectors. It is the responsibility of the householder to ensure that the system is regularly maintained so that it does not cause pollution or ponding.

Attention is also drawn to condition No.3 of the enclosed consent which requires that the tank must be desludged at least once every year, and you will need to ensure that there is suitable vehicle access to the system. A desludging service is carried out by Northern Ireland Water Limited and this service is also provided by some private contractors. Northern Ireland Water Limited can be contacted on 08457 440088 and names of sewage consultants can be found in the Yellow Pages.

I hope this information is of use and if you require any further clarification, please contact me on 028 9262 3230.

Yours faithfully



Samuel McCollum
Water Regulation Team

A living, working, active landscape valued by everyone.



An Agency within the Department of
**Agriculture, Environment
and Rural Affairs**

www.daera-ni.gov.uk



**INVESTORS
IN PEOPLE**

DEPARTMENT OF Agriculture, Environment and
Rural Affairs
Water (Northern Ireland) Order 1999

Consent Number : CN 2733/2009

File Reference : NC 2320/2009

Review Consent to the Discharge of Effluent

The Department of Agriculture, Environment and Rural Affairs in pursuance of the power conferred on it by the Water (Northern Ireland) Order 1999 HEREBY CONSENTS to your review making a discharge into an underground stratum and into a waterway in accordance with 26/08/2009 application received in respect of your premises at :

MAGONRAGH

LISELLAW

CO FERMANAGH

BT94 5EP

(per attached map)


SUBJECT TO the following conditions :

1. The effluent discharged to the waterway via underground stratum shall not:
 - (a) have a biochemical oxygen demand in excess of 40 mgs per litre;
 - (b) contain suspended solids in excess of 60 mgs per litre;
 - (c) exceed 1 cubic metre(s) per day;
 - (d) contain any substance (other than as defined in (b) above) which will cause the waterway to be toxic or injurious to fish or other aquatic organisms.
2. All surface water shall be excluded from the system.
3. The tank shall be desludged at least once every year.
4. Facilities shall be available for sampling the final effluent.
5. The sampling point shall be at the purpose built chamber immediately after the biological filter.
6. The effluent shall be discharged into a sub-surface irrigation system:
 - (a) which shall not be less than 45 metres in length and;
 - (b) which shall be designed and installed in accordance with the recommendations contained in the BS Code of Practice (BS 6297:2007).

Department Agriculture,
Environment and Rural Affairs
Northern Ireland Environment Agency
17 Antrim Road
Lisburn
BT28 3AL

Dated this 17th day of January, 2019

.....
Authorised Officer

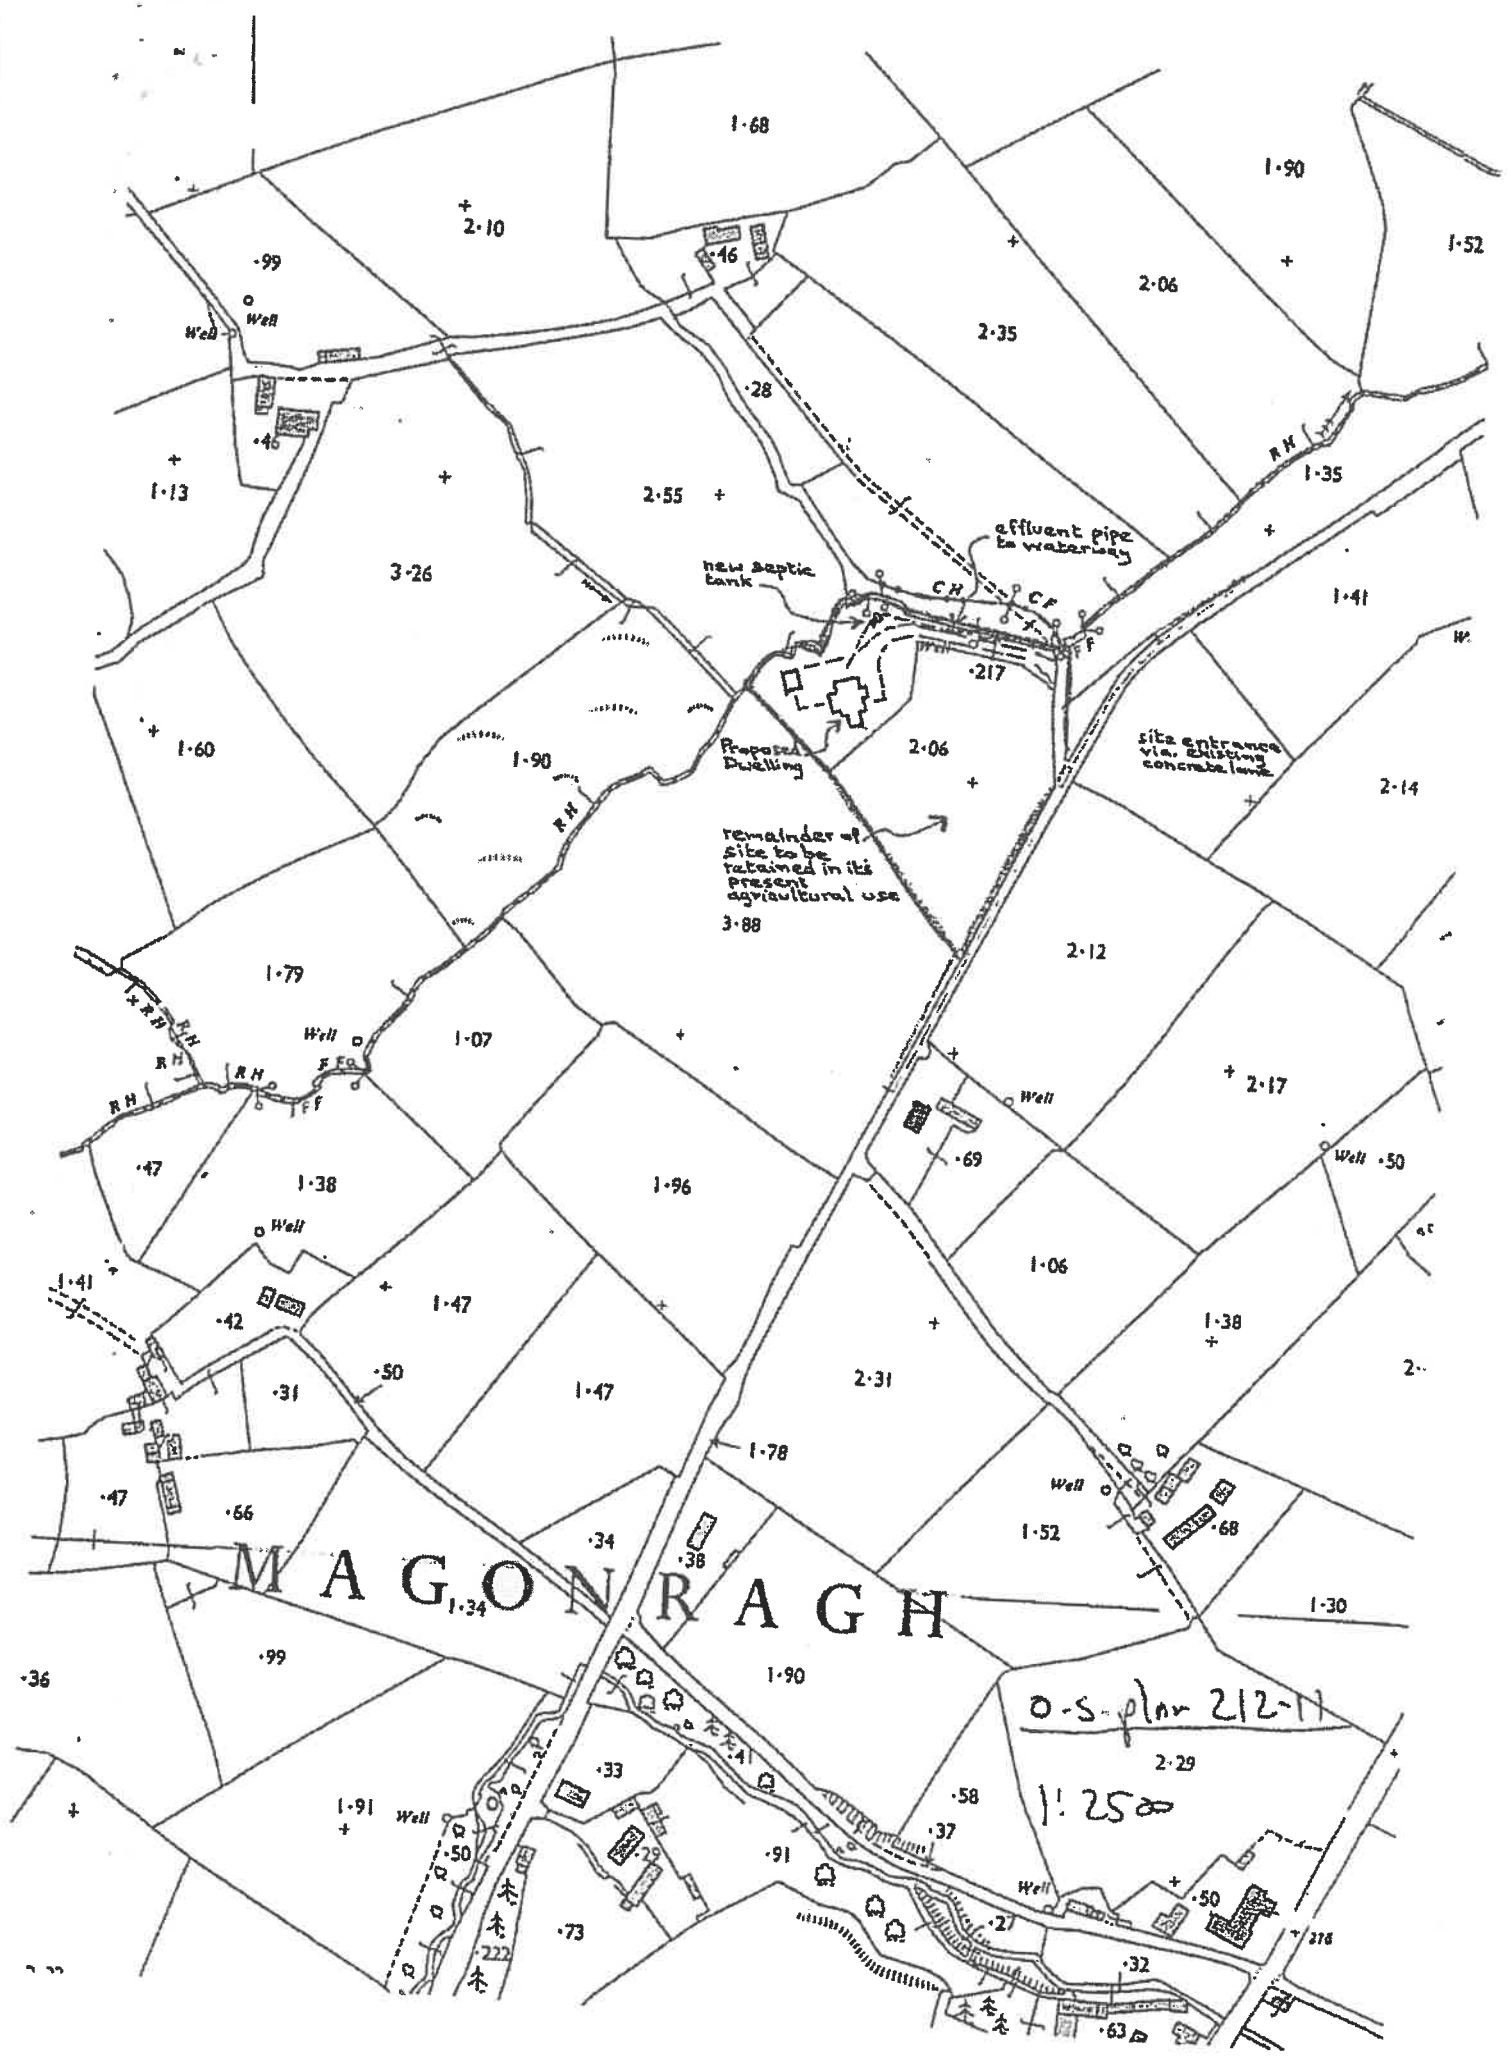

DEPARTMENT OF THE ENVIRONMENT
Water (Northern Ireland) Order 1999

Consent Number : CN 2733/2009
File Reference : NC 2320/2009

Review Consent to the Discharge of Effluent

The Department of the Environment in pursuance of the power conferred on it by the Water (Northern Ireland) Order 1999 HEREBY CONSENTS to your review making a discharge into an underground stratum and into a waterway in accordance with your application received 26/08/2009 in respect of your premises at :


MAGONRAGH
LISBELLAW
CO FERMANAGH
BT94 5EP (per attached map)

SUBJECT TO the following conditions :

1. The effluent discharged to the waterway via underground stratum shall not:
 - (a) have a biochemical oxygen demand in excess of 40 mgs per litre;
 - (b) contain suspended solids in excess of 60 mgs per litre;
 - (c) exceed 1 cubic metre(s) per day;
 - (d) contain any substance (other than as defined in (b) above) which will cause the waterway to be toxic or injurious to fish or other aquatic organisms.
2. All surface water shall be excluded from the system.
3. The tank shall be desludged at least once every year.
4. Facilities shall be available for sampling the final effluent.
5. The sampling point shall be at the purpose built chamber immediately after the biological filter.
6. The effluent shall be discharged into a sub-surface irrigation system:
 - (a) which shall not be less than 45 metres in length and;
 - (b) which shall be designed and installed in accordance with the recommendations contained in the BS Code of Practice (BS 6297:2007).

Department of the Environment
Northern Ireland Environment Agency
17 Antrim Road
Lisburn
BT28 3AL

Dated this 11th day of November, 2009


Authorised Officer

