


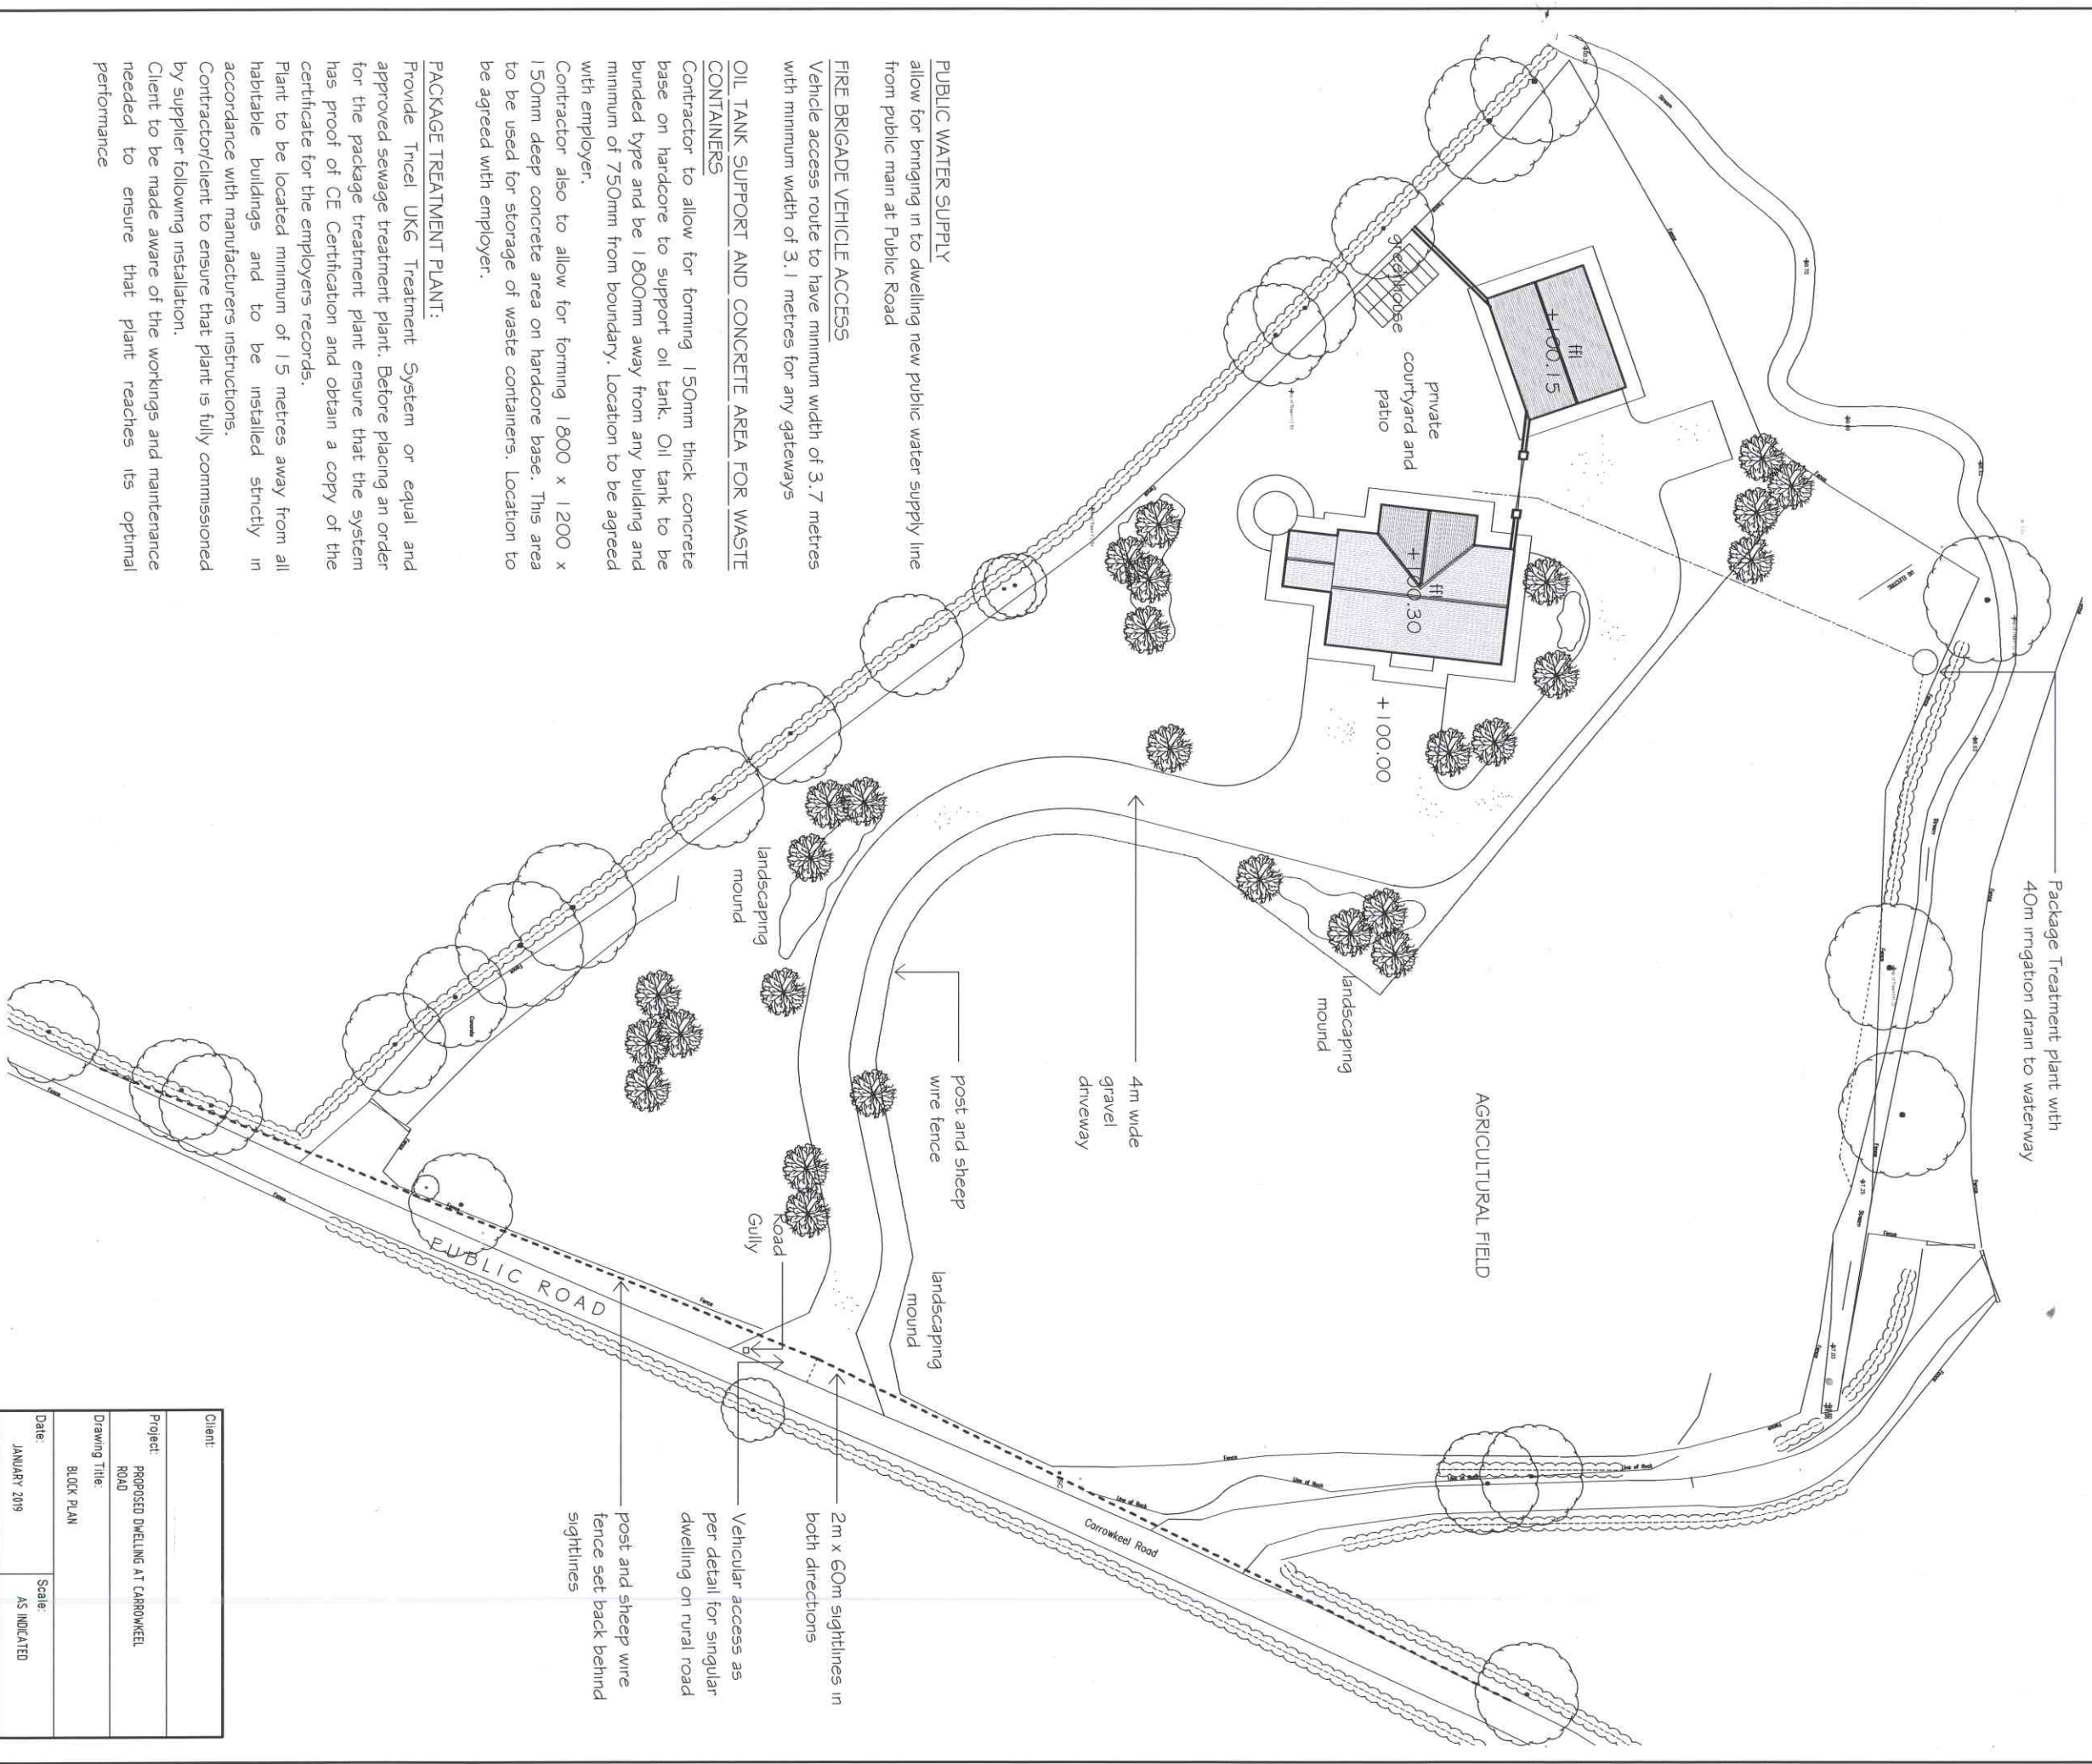

## PUBLIC WATER SUPPLY

allow for bringing in to dwelling new public water supply line from public main at Public Road

## FIRE BRIGADE VEHICLE ACCESS

Vehicle access route to have minimum width of 3.7 metres with minimum width of 3.1 metres for any gateways

# OIL TANK SUPPORT AND CONCRETE AREA FOR WASTE CONTAINERS

Contractor to allow for forming 150mm thick concrete base on hardcore to support oil tank. Oil tank to be bundled type and be 1800mm away from any building and minimum of 750mm from boundary. Location to be agreed with employer.

Contractor also to allow for forming 1800 x 1200 x 150mm deep concrete area on hardcore base. This area to be used for storage of waste containers. Location to be agreed with employer.

PACKAGE TREATMENT PLANT:

Provide in-cel UK6 Treatment System or equal and approved sewage treatment plant. Before placing an order for the package treatment plant ensure that the system has proof of CE Certification and obtain a copy of the certificate for the employers records.

Plant to be located minimum of 15 metres away from all habitable buildings and to be installed strictly in accordance with manufacturers instructions.

Contractor/client to ensure that plant is fully commissioned by supplier following installation.

Client to be made aware of the workings and maintenance needed to ensure that plant reaches its optimal performance



# BLOCK PLAN

1:500

Existing trees at boundary to be retained



New Hawthorne Hedge

New trees (2m high at time of planting)  
(species of tress denoted as follows A = alder, B = birch,  
CA = crab tree, R = rowan, W = willow)



New trees and shrubs to be planted during first available planting season and any tree or shrub dying during first five years to be replaced.

|                                                                                                   |                                      |           |                 |
|---------------------------------------------------------------------------------------------------|--------------------------------------|-----------|-----------------|
| Client:                                                                                           |                                      |           |                 |
| Project:                                                                                          | PROPOSED DWELLING AT CARHOMWELL ROAD |           |                 |
| Drawing Title:                                                                                    | BLOCK PLAN                           |           |                 |
| Date:                                                                                             | JANUARY 2019                         | Scale:    | AS INDICATED    |
| Dwg No:                                                                                           | 4791 / 02                            | Revision: | [ ] [ ] [ ] [ ] |
| 30 Cullion Road   Edenmore<br>Tempo   Co. Fermanagh<br>T: 028 8954 1416<br>E: info@augenahome.com |                                      | A3        |                 |