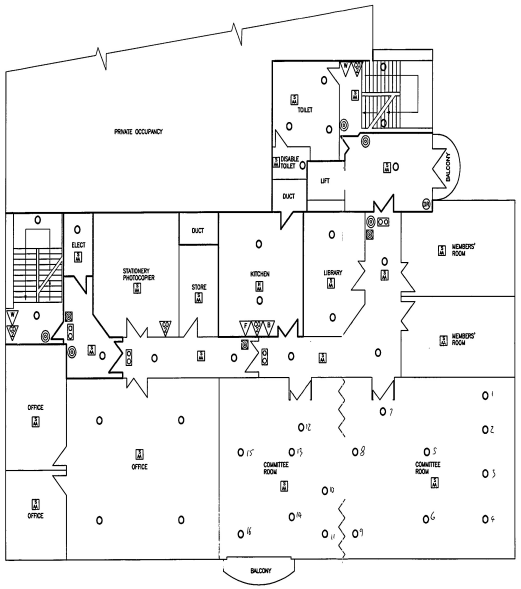


WP Weather protection
Fire resisting doors 30 minutes minimum
Fire resisting doors 60 minutes minimum
Fire resisting construction 30 minutes minimum
60 Fire resisting construction 60 minutes minimum
// Internal Glazing

VL Vertical ladder
VP Vision panel
PEL Panic escape latches
EOD Easy opening devices
SC Self closing devices
SC/A Automatic releases
FFF Free from fastenings
HRL Handrail
GRL Guardrail
PB Push bar to open
OO Outward opening
DS Double swing
FRG Fire resisting glazing
FR Fire resisting

Fire extinguisher water type
Fire extinguisher foam type
Fire extinguisher dry powder type
Fire extinguisher carbon dioxide type
Fire extinguisher vapourising liquid type
Fire extinguisher aqueous film forming foam type
Fire blanket
Sand bucket
Hose reel
Fire alarm call point
Audible warning devices
Visual warning devices
Exchange telephone
Manual fire alarm sounder
Internal telephone alarm system
Automatic smoke detector
Door Release Break Glass
Automatic heat detector
Emergency lighting points
Illuminated exit boxes
Illuminated exit boxes with directional arrow
Fire exit sign
Fire exit sign with directional sign
Automatic control panel threaded key (circle fire door)
Intumescent point (Harmox)
FA1 Fire Action (General)
FA2 Fire Action (Telephone Operators)
FA3 Fire Action (Gate Keepers,Door Keepers and Receptionists)
FA4 Fire Action (Reprographic and Print Rooms)
FA5 Fire Action (Guest Bedrooms)
Available From Construction Service Fire Section
N1 "Slide to open" notice
N2 "Fire escape-keep clear" notice
N3 "Fire door-keep shut" notice
N4 "Push bar to open" notice
N5 Door secured in open position notice
N6 "Fire door-keep locked shut" notice
Indicator panel
Key in glass box
Hydrant
Dry riser
Key in glass fronted box
Tannoy speaker
Outside Light

CONSTRUCTION SHOWN IN BOLD LINES IS ACCEPTED AS PROVIDING A MINIMUM OF 1/2 HOUR FIRE RESISTANCE, UNLESS OTHERWISE INDICATED. DOORS SHOWN IN BOLD LINES ARE ACCEPTED AS PROVIDING A MINIMUM OF 1/2 HOUR FIRE RESISTANCE. THEY MUST BE EFFECTIVELY MAINTAINED AS SELF-CLOSING, OR AS IN THE CASE OF STORE DOORS "KEPT LOCKED SHUT" WHEN NOT IN USE. THE APPROPRIATE NOTICE IS DISPLAYED ON ALL FIRE DOORS.

HEALTH AND SAFETY EXECUTIVE
FOR NORTHERN IRELAND
83 LADAS DRIVE
BELFAST BT6 9FJ
TELEPHONE (01232) 251333

MEANS OF ESCAPE IN CASE OF FIRE

NAME AND ADDRESS
WATERSIDE TOWER
CLARENDON DOCK
BELFAST

SECOND FLOOR PLAN

| | |
|---|---|
| FILE REFERENCE NUMBER | |
| COMPUTER REFERENCE CODE | 6092s102 |
| DRAWING SHEET NUMBER | 3 of 6 |

THE FIRE SERVICES (NORTHERN IRELAND) ORDER 1984 NO.1821

| | |
|---|---|
| PREPARED BY | DW |
| DATE | APRIL 2002 |
| SCALE | 1:100 |
| INSPECTING OFFICER | R McKAY |
| THIS PLAN FORMS PART OF FIRE CERTIFICATE NUMBER: | FC 003 02 |

FIRE CERTIFICATE FC 003 02
DRAWING No. 3 of 6
AMENDED 12th MAY 2005