


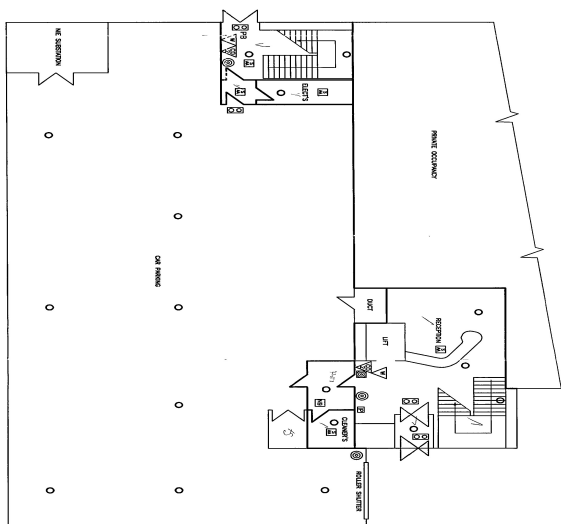

FIRE CERTIFICATE FC 003 0
DRAWING No. 1 of 6
AMENDED 12th MAY 2005

AMENDED 12th MAY 2005

AMENDED 12th MAY 2005

[illegible]

CONSTRUCTION SHOWN IN BOLD LINES IS ACCEPTED. PROVIDING A MINIMUM OF 1/2 HOUR FIRE RESISTANCE UNLESS OTHERWISE INDICATED. DOORS SHOWN IN BOLD LINES ARE ACCEPTED AS PROVIDING A MINIMUM OF 1 HOUR FIRE RESISTANCE. THEY MUST BE EFFECTIVELY MAINTAINED AS SELF-CLOSING, OR AS IN THE CASE STORE DOORS, NEET LOOKED SHUT WHEN NOT IN USE. THE APPROPRIATE NOTICE IS DISPLAYED ON ALL FIRE DOORS.

HEALTH AND SAFETY EXECUTIVE FOR NORTHERN IRELAND BELFAST BT9 TELEPHONE (01232) 261533	MEANS OF ESCAPE IN CASE OF FIRE	NAME AND ADDRESS CHERRIES TOWER CARBONEN DOCK SE-FAST GROUND FLOOR PLANT	ALL RESIDENCE NUMBER 9520400 1 of 6	THE FIRE SERVICE (NORTHERN IRELAND) ORDER NO. 101281	ISSUED BY DATE 1/10/2002 BY M. MCINTYRE	THE MAIN POINT NAME OF THE OFFICE/MAINTENANCE PERSON	FE 002 02
--	---------------------------------	--	---	---	---	--	-----------