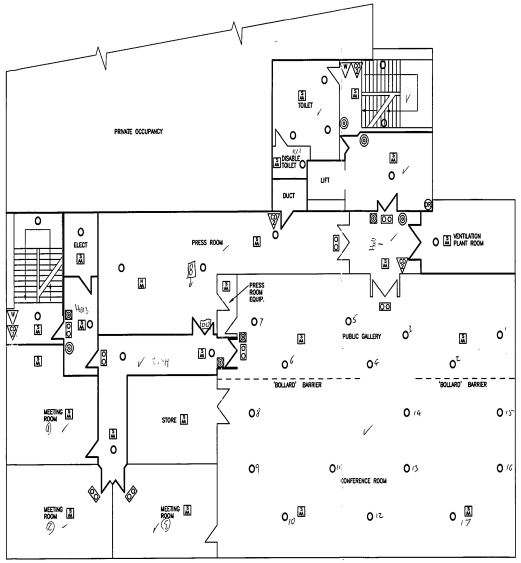

1 Stair 2
2 Mrs Coyle's room
3 Estate

WP	Weather protection		Fire resisting construction 30 minutes minimum
	Fire resisting doors 30 minutes minimum	60	Fire resisting construction 60 minutes minimum
60	Fire resisting doors 60 minutes minimum	//	Internal Glazing
VL	Vertical ladder	HRL	Handrail
VP	Vision panel	GRL	Guardrail
PEL	Panic escape latches	PB	Push bar to open
EOD	Easy opening devices	OO	Outward opening
SC	Self closing devices	DS	Double swing
SC/A	Automatic releases	FRG	Fire resisting glazing
FFF	Free from fastenings	FR	Fire resisting

Fire extinguisher water type

Fire extinguisher foam type

Fire extinguisher dry powder type

Fire extinguisher carbon dioxide type

Fire extinguisher vaporising liquid type

Fire extinguisher aqueous film forming foam type

Fire blanket — Sand bucket

Hose reel — Fire alarm call point

Audible warning devices — Visual warning devices

Exchange telephone — Manual fire alarm sounder

Internal telephone alarm system

Automatic smoke detector

Automatic heat detector — Door Release Break Glass

Emergency lighting points

Illuminated exit boxes

Illuminated exit boxes with directional arrow

Fire exit sign

Fire exit sign with directional sign

Automatic control panel threaded key (circle line door)

Internment point (Hamrex)

FA1 Fire Action (General)
FA2 Fire Action (Telephone Operators)
FA3 Fire Action (Gate Keepers/Door Keepers and Receptionists)
FA4 Fire Action (Reprographic and Print Room)
FA5 Fire Action (Guest Bedrooms)
} Available From Construction Service Fire Section

M1 "Slide to open" notice

M2 "Fire escape-keep clear" notice

M3 "Fire door-keep shut" notice

M4 "Push bar to open" notice

M5 Door secured in open position notice

M6 "Fire door-keep locked shut" notice

Indicator panel — Key in glass box

Hydrant — Dry riser

Key in glass fronted box — Tannoy speaker

Outside Light

CONSTRUCTION SHOWN IN BOLD LINES IS ACCEPTED AS PROVIDING A MINIMUM OF 1/2 HOUR FIRE RESISTANCE, UNLESS OTHERWISE INDICATED. DOORS SHOWN IN BOLD LINES ARE ACCEPTED AS PROVIDING A MINIMUM OF 1/2 HOUR FIRE RESISTANCE. THEY MUST BE EFFECTIVELY MAINTAINED AS SELF-CLOSING, OR AS IN THE CASE OF STORE DOORS "KEPT LOCKED SHUT" WHEN NOT IN USE. THE APPROPRIATE NOTICE IS DISPLAYED ON ALL FIRE DOORS.

HEALTH AND SAFETY EXECUTIVE
FOR NORTHERN IRELAND
83 LADAS DRIVE
BELFAST BT6 9FJ
TELEPHONE (01232) 251333

MEANS OF ESCAPE IN CASE OF FIRE

NAME AND ADDRESS
WATERSIDE TOWER
CLARENDON DOCK
BELFAST
FIRST FLOOR PLAN

FILE REFERENCE NUMBER	
COMPUTER REFERENCE CODE	6092w101
DRAWING SHEET NUMBER	2 of 6

THE FIRE SERVICES (NORTHERN IRELAND) ORDER 1984 NO.1821

PREPARED BY	DW
DATE	APRIL 2002
SCALE	1:100
INSPECTING OFFICER	R McKAY
THIS PLAN FORMS PART OF FIRE CERTIFICATE NUMBER:	FC 003 02

FIRE CERTIFICATE FC 003 02
DRAWING No. 2 of 6
AMENDED 12th MAY 2005